



SHALL BE MINIMUM OF 1" TAP
SEE NOTE 1

4" X 1" TAPPING SADDLE



CORPORATION STOP

WATERLINE

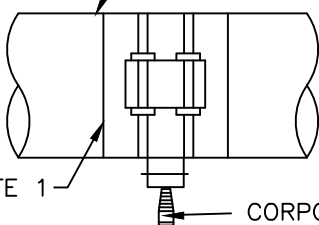

SEE NOTE 1


CORPORATION STOP

NOTES:

1. TAPPING SADDLE TO BE DUCTILE IRON WITH TYPE 304 STAINLESS STEEL FORGED DOUBLE STRAPS, STAINLESS STEEL BOLTS, NUTS, AND WASHERS. FINISH IS FUSION BONDED EPOXY TO AVERAGE THICKNESS OF 12MILS.
2. ALL 1" AND 2" TAPS ON WATER LINES SMALLER THAN 6"(SIX INCHES) WILL REQUIRE A TAPPING SADDLE. ALL TWO INCH (2") TAPS WILL REQUIRE A TAPPING SADDLE, REGARDLESS OF WATER MAIN SIZE.
3. A VALVE BOX SHALL BE USED FOR 2" CORPORATION STOPS.(SEE DETAIL W4)

1" & 2" WATER TAPPING SADDLE

STANDARD
CONSTRUCTION
DETAILS



CITY OF
savannah

WATER RESOURCES AND PUBLIC WORKS BUREAU
Planning & Engineering

SCALE: N.T.S.

DATED: SEP 2013

PLATE NUMBER:

W3